


speed скорост скорост	pit дъно прямок	headroom таван потолок
0.5	1000	3600

pers. лица пасс.	kg кг	A mm	B mm	C mm	D mm	E mm
33	2500	2800	3000	2000	2460	1800
40	3000	2800	3400	2000	2860	1800
46	3500	3000	3500	2200	2960	2000
53	4000	3000	3900	2200	3330	2000

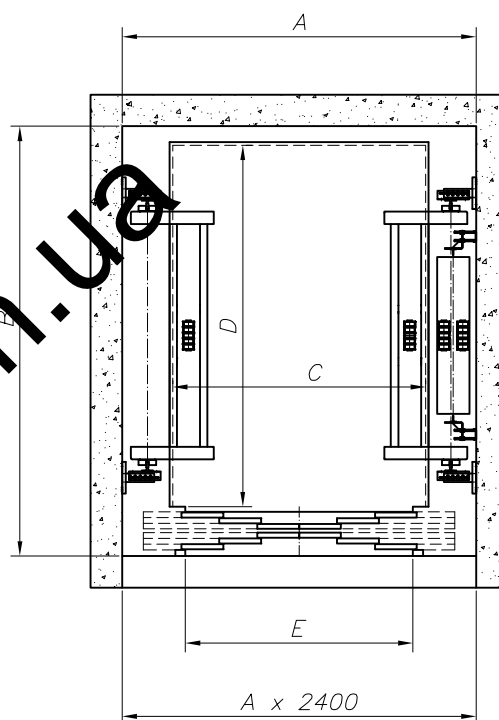

1. Deviations of the hoistway width and depth from the nominal sizes – between -20 mm $+30$ mm.
2. Difference between the hoistway diagonals – not more than 30 mm.
3. The deviation of the axis of the shaft in the vertical – not more than 30 mm.
4. The hoistway should not be placed over areas accessible to people.

1. Отклоненията на широчината и дълбочината на шахтата от номиналните им размери – от -20 мм до $+30$ мм.
2. Разликата в диагоналите на шахтата – не по-голяма от 30 мм.
3. Отклонението на оста на шахтата по вертикала – не по-голямо от 30 мм.
4. Шахтата да не се разполага над пространства, достъпни за хора.

1. Отклонение ширини и глубини шахты от номинальных размеров должно быть в диапазоне от -20 мм до $+30$ мм.
2. Различие в диагоналях шахты должно быть не более 30 мм.
3. Отклонение оси шахты по вертикали должно быть не более 30 мм.
4. Шахта не располагается над пространством, доступным для людей.